



7" PLAIN CONCRETE WITH INTEGRAL CURB ASPHALT WITH CONCRETE COMBINATION CURB AND GUTTER

**RESIDENTIAL PAVEMENT
CONDITION 1**

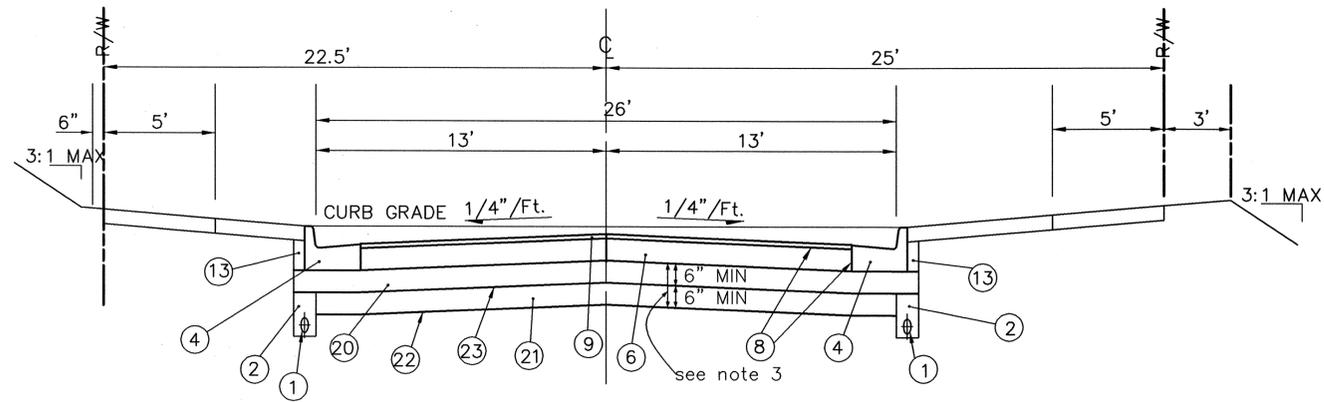

**RESIDENTIAL PAVEMENT
CONDITION 1 (PLANNED UNDERCUT)**

ASPHALT WITH CONCRETE COMBINATION CURB AND GUTTER

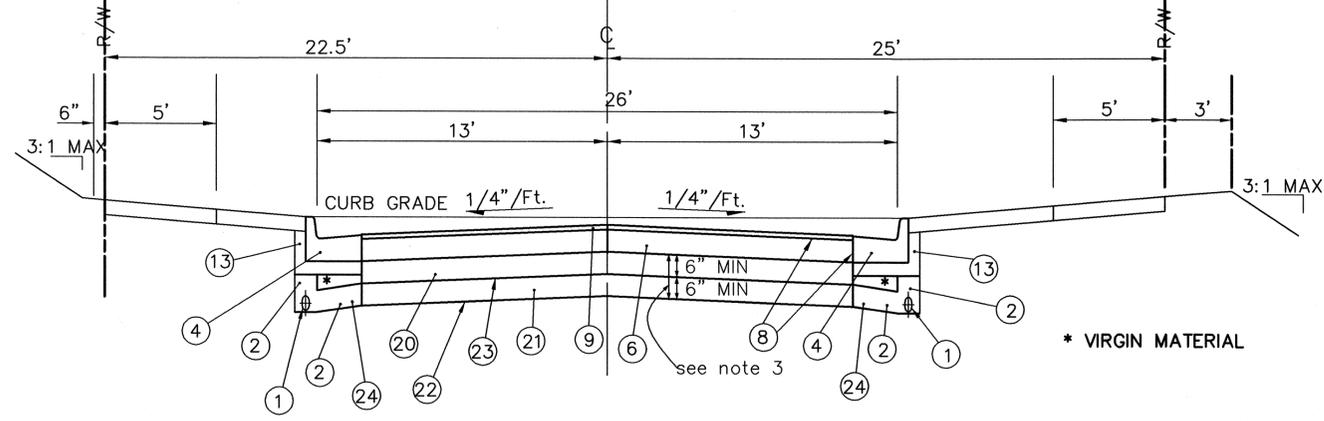

**RESIDENTIAL PAVEMENT
CONDITION 1 (UNPLANNED UNDERCUT)**

ASPHALT WITH CONCRETE COMBINATION CURB AND GUTTER

* VIRGIN MATERIAL

NOTES


- 1 REFER TO CONDITION 1 PAVEMENT FOR ALL ITEMS NOT SHOWN ON CONDITION 2 AND CONDITION 3 PAVEMENT.
- 2 WHEN THE DESIGN CALLS FOR CONDITION 3 PAVEMENT, DETAILS SHOULD BE PROVIDED ON THE PLAN TO ADDRESS SPECIAL CONDITIONS FOR UNDERDRAIN AND HOUSEDRAIN PIPE.
- 3 THICKNESS AND TYPE OF EACH LAYER OF AGGREGATE REFILL SHALL BE DETERMINED BY THE ENGINEER. IF THE TOTAL THICKNESS OF BOTH LAYERS OF AGGREGATE REFILL EXCEEDS 12", AN ADDITIONAL LAYER OF GEOGRID WILL BE INSTALLED BETWEEN THE TYPES OF AGGREGATE REFILL AS INDICATED BY 23.

FOR CURB DETAILS, SEE DWG No. BP-2


FOR PLAIN CONCRETE PAVEMENT DETAILS, SEE DWG No. BP-3

FOR SIDEWALK DETAILS, SEE DWG Nos. BP-5.0 AND 5.1


| CODE | DESCRIPTION | ITEM No. | PAYMENT |
|------|--|----------|----------------|
| 1 | 4" PIPE UNDERDRAINS | 564 | L.F. |
| 2 | WASHED GRAVEL OR CRUSHED STONE | | INCLUDED 564 |
| 3 | 4" POROUS SUBBASE | | INCLUDED 455 |
| 4 | COMBINATION CURB AND GUTTER | 455 | L.F. |
| 6 | BITUMINOUS AGGREGATE BASE, 6" THICK | 301 | C.Y. |
| 8 | TACK COAT | 407 | GAL. |
| 9 | ASPHALT CONCRETE SURFACE COURSE, TYPE 1, 1 1/4" THICK | 448 | C.Y. |
| 10 | 7" PLAIN PORTLAND CEMENT CONCRETE PAVEMENT | 452 | S.Y. |
| 13 | POROUS BACKFILL | | INCL. 452, 455 |
| 14 | CONCRETE WALK, 4" THICK OR 6" THICK | 456 | S.F. |
| 15 | TOPSOIL, 4" THICK | 653 | S.Y. |
| 16 | SEEDING AND MULCHING | 659 | S.Y. |
| 17 | SODDING ON 4" TOPSOIL | 660 | S.Y. |
| 19 | CURB, 6" X 18", MODIFIED | 455 | L.F. |
| 20 | AGGREGATE REFILL TYPE 1 (LIMESTONE) | 203 | C.Y. |
| 21 | AGGREGATE REFILL TYPE 2 | 203 | C.Y. |
| 22 | BX1300 GEOGRID | 609 | S.Y. |
| 23 | BX1200 GEOGRID, ONLY AS DIRECTED | 609 | S.Y. |
| 24 | DRAIN(12" WIDE X 6" THICK) EVERY 50' AND LOW POINTS, AS DIRECTED | | INCLUDED 564 |

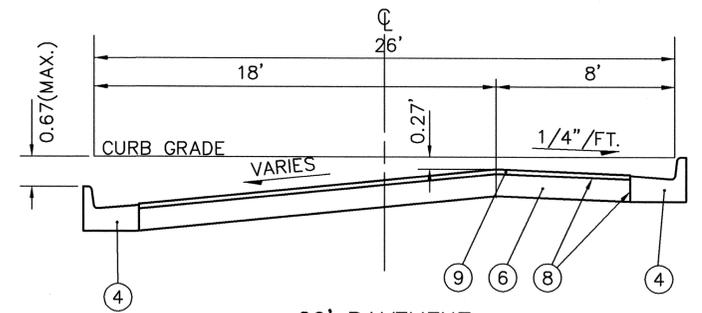

26' PAVEMENT
**SPLIT GRADE RESIDENTIAL PAVEMENT
CONDITION 2 - ASPHALT PAVEMENT**

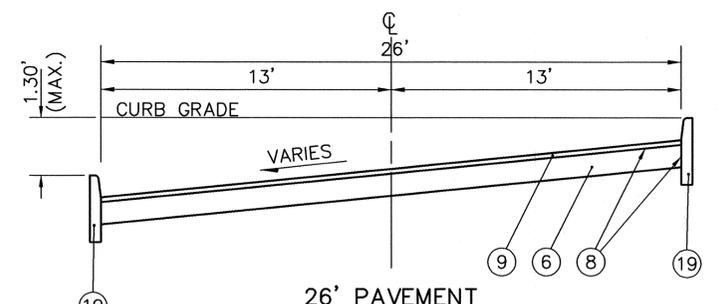

26' PAVEMENT
**SPLIT GRADE RESIDENTIAL PAVEMENT
CONDITION 3**

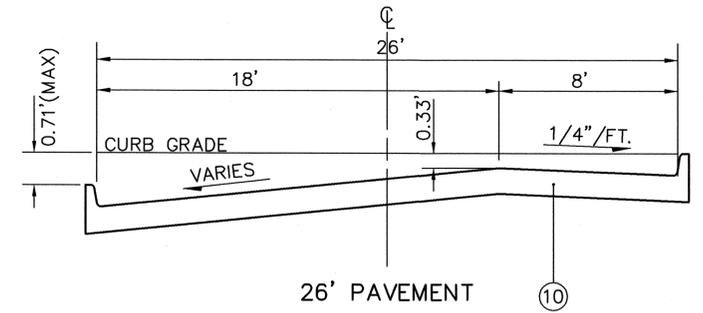

26' PAVEMENT
**SPLIT GRADE RESIDENTIAL PAVEMENT
CONDITION 2 - CONCRETE PAVEMENT W/ INTEGRAL CURB**

DO NOT SCALE - USE DIMENSIONS ONLY

| | |
|--|---|
| CITY OF AKRON BUREAU OF ENGINEERING | CONSTRUCTION STANDARD DWG. No. BP-1 |
| <i>R.C. Wald</i> 5-30-08 ACTING MANAGER, DESIGN DIVISION | PAVEMENT TYPICAL SECTIONS RESIDENTIAL PAVEMENT |
| <i>Dennis O. Wald</i> 6-2-08 MANAGER, CONSTRUCTION DIVISION | |
| <i>DJCH</i> 6-2-08 CITY ENGINEER | |
| REVISIONS: APRIL 4, 2008 | |