


TOP VIEW C-C

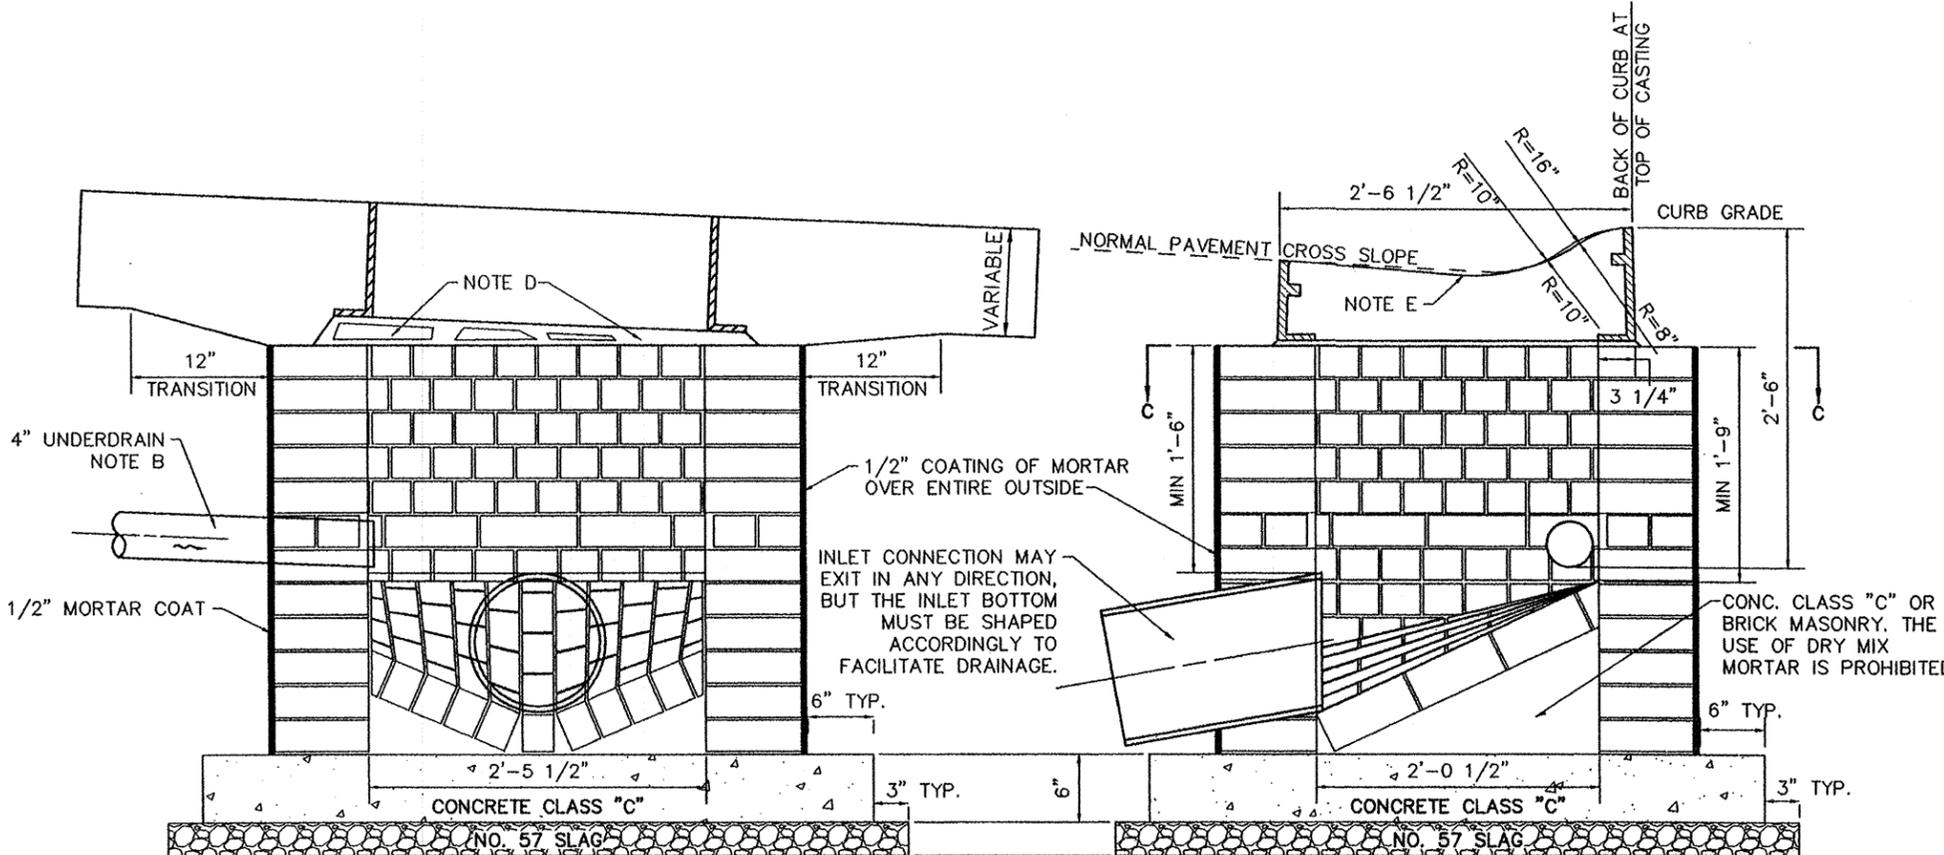

FRONT VIEW SECTION A-A

SIDE VIEW SECTION B-B

TYPICAL OF 4" ROLLED COMBINATION CURB AND GUTTER OR CONCRETE PAVEMENT WITH 4" ROLLED CURB.

- A. MATERIAL SHALL BE CAST IRON MEETING THE REQUIREMENTS OF 711.12. UPON COMPLETION OF ALL WORK, THE LID SEAT SHALL BE THOROUGHLY CLEANED OF ALL DIRT, CONCRETE OR OTHER DEBRIS TO INSURE A FIRM SEAT AND EASE OF REMOVAL.
- B. INSTALL UNDERDRAIN PIPE THROUGH INLET WALL ON UPHILL SIDE, OR ON BOTH SIDES IF INLET IS IN A SUMP.
- C. 8" BRICK WALL LAID UP IN PORTLAND CEMENT MORTAR, EVERY SEVENTH COURSE TO BE A STRETCHER COURSE.
- D. USE BRICK PIECES FOR FILLER WHEN CASTING IS MORE THAN 1" OFF BRICK. SET CASTING ON FULL MORTAR BED.
- E. DEPRESS CASTING SLIGHTLY BELOW PAVEMENT SURFACE.

DO NOT SCALE - USE DIMENSIONS ONLY

CITY OF AKRON BUREAU OF ENGINEERING	CONSTRUCTION STANDARD DWG. No. 1-2.2
<i>Michael J. Madonia</i> 3/14/02 MANAGER, DESIGN DIVISION	NO. 2R INLET
<i>James P. Phelan</i> 3/15/02 MANAGER, CONSTRUCTION DIVISION	
<i>David J. Jelic</i> 3-15-02 CITY ENGINEER	
AUTOCAD DRAWING -- STD_J-5.DWG February 28, 2002	
REVISIONS:	