



MUST MAINTAIN A 48" PREF. (36" MIN.) CLEAR WIDTH OF CONTINUOUS PASSAGE AROUND CORNER OR OBSTRUCTION.

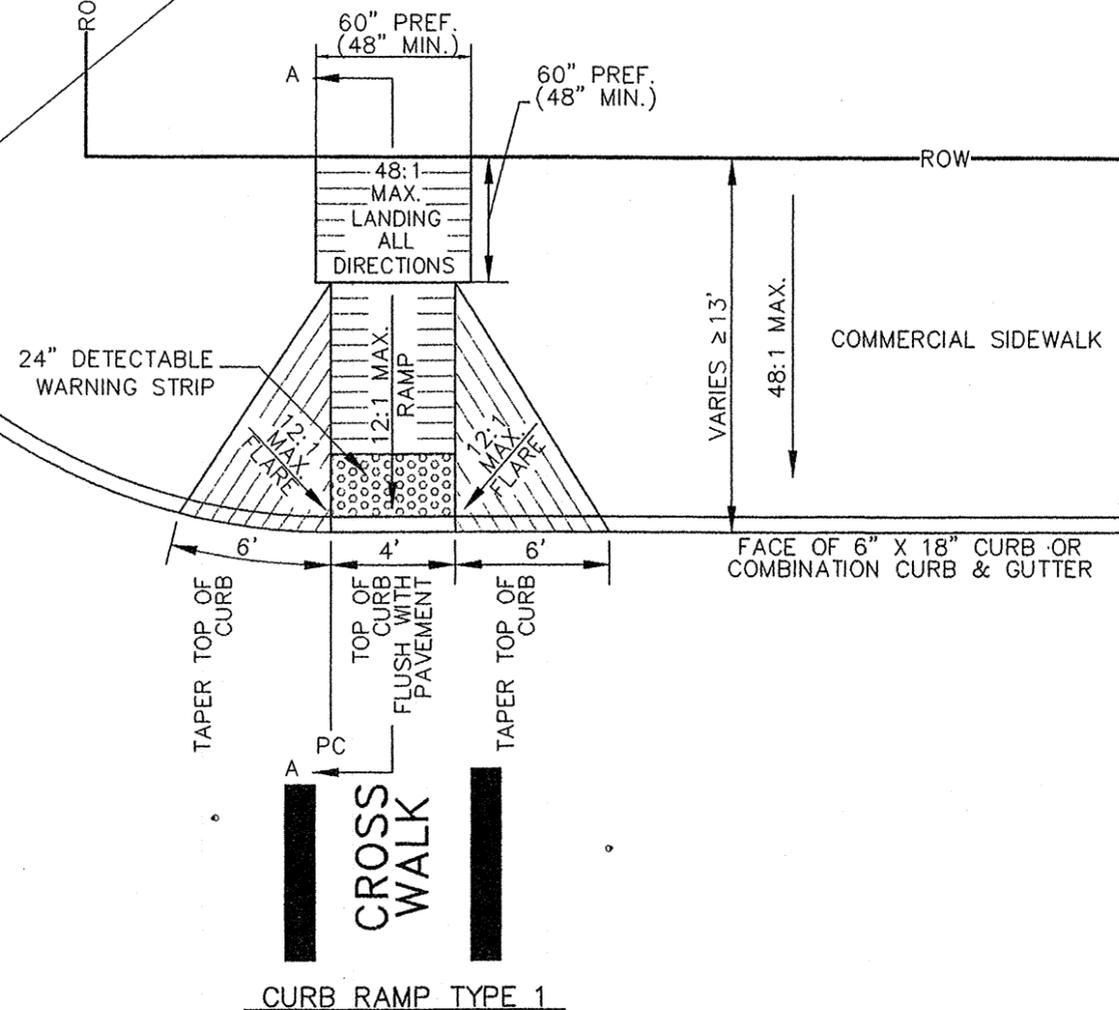

CROSS WALK


MUST PROVIDE MINIMUM 48"x48" CLEAR AREA WITHIN BOTH CROSSWALKS

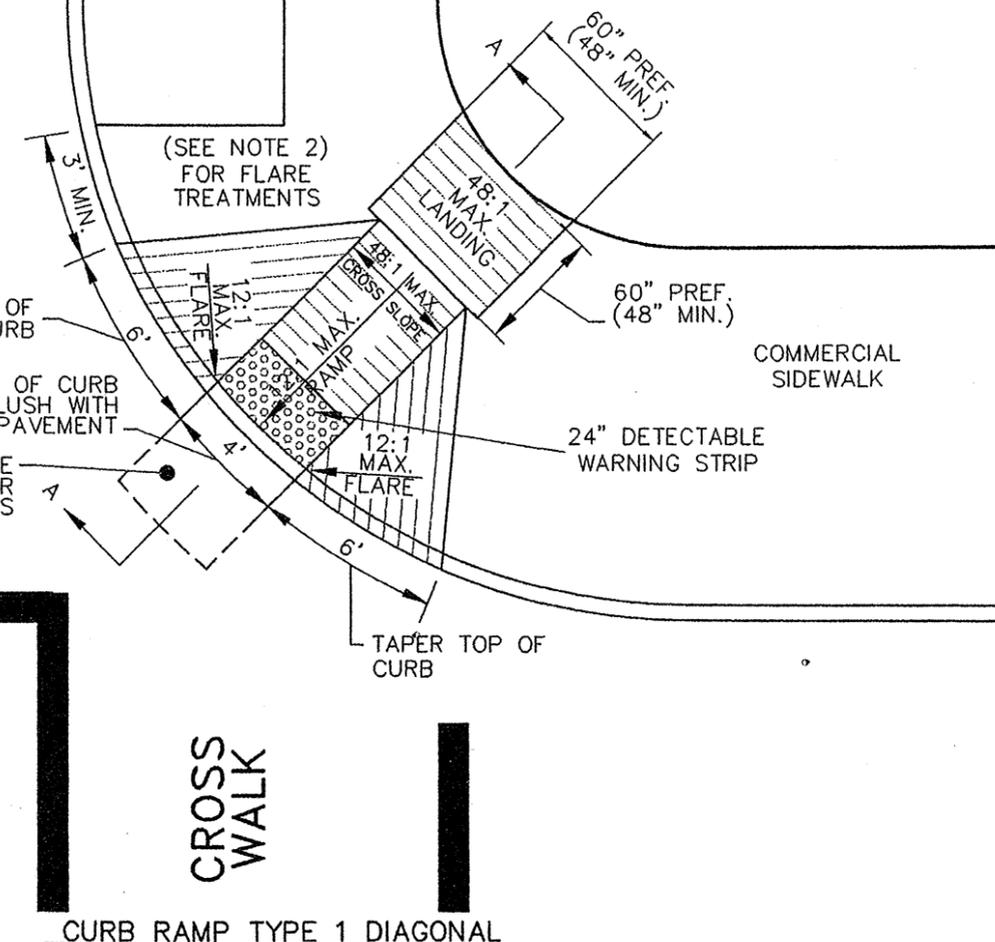

CURB RAMP TYPE 1 DIAGONAL

- NOTES:
1. FLARE OF 6' TYPICAL FOR 6" CURB REVEAL AND 12:1 SLOPE, MAY BE MORE OR LESS FOR EXISTING CURB REVEALS WHEN CURB REVEAL HEIGHT IS NOT BEING ALTERED.
 2. ALTERNATE FLARE TREATMENTS MAY BE USED UPON APPROVAL BY THE ENGINEER, AS FOLLOWS:
 - 1) INTEGRAL ROLLED CURBING AT 6-INCHES WIDTH
 - 2) NO CURBING OR FLARE TREATMENT
 - 3) CORNER SIDE FLARE MAY BE 12:1 TO CONCRETE WALK; PROVIDE MIN. 3' CONCRETE AT TOP OF FLARE TO EXTENDED SIDEWALK LINE.

DO NOT SCALE - USE DIMENSIONS ONLY

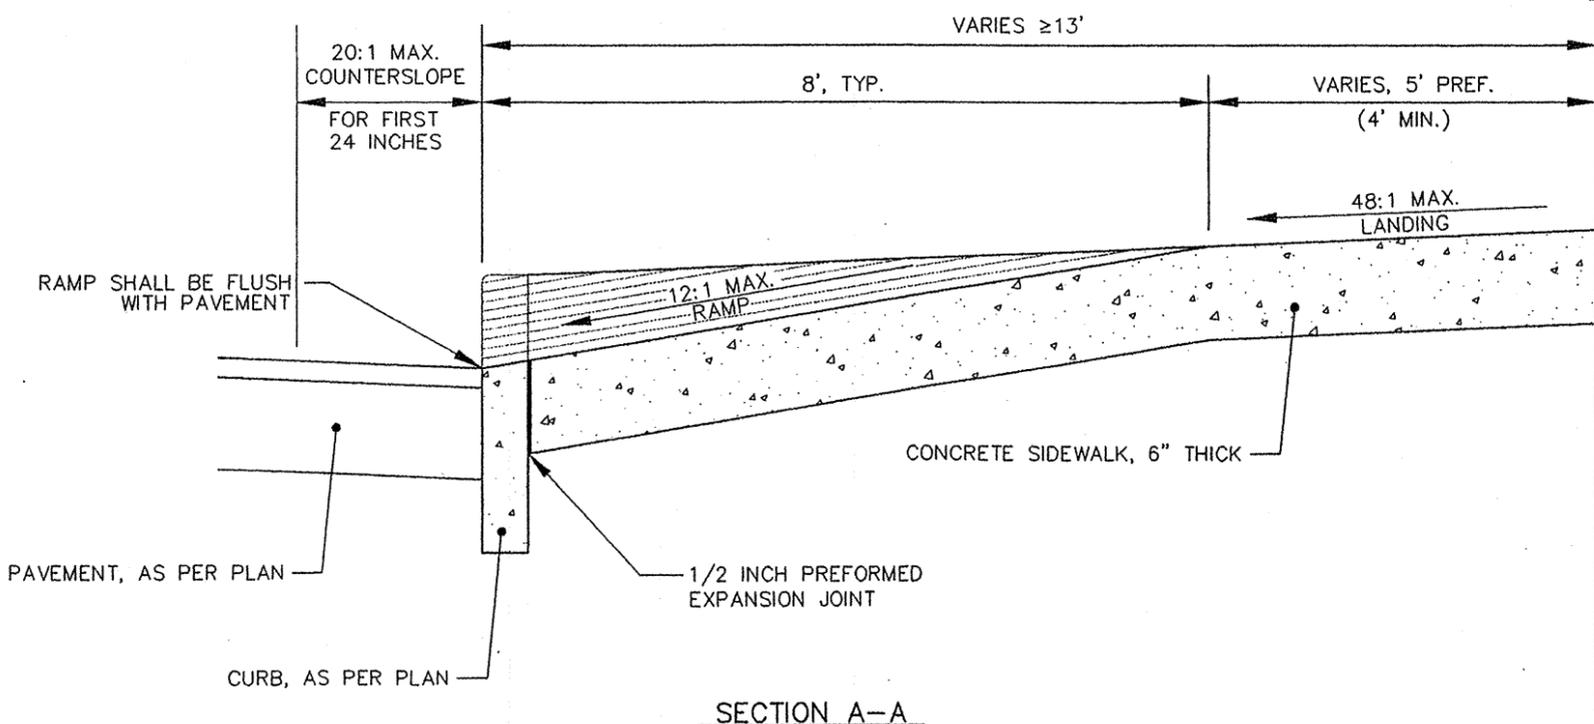

CITY OF AKRON BUREAU OF ENGINEERING	CONSTRUCTION STANDARD DWG. No. BP-5.3
<i>Michael L. Madonia</i> 1-15-02 MANAGER, DESIGN DIVISION	CURB RAMP TYPE 1 PERPENDICULAR
<i>James P. Welter</i> 1-22-02 MANAGER, CONSTRUCTION DIVISION	
<i>David J. ...</i> 1-22-02 CITY ENGINEER	
AUTOCAD DRAWING - STD_BP-5.3.DWG January 11, 2002	
REVISIONS:	